
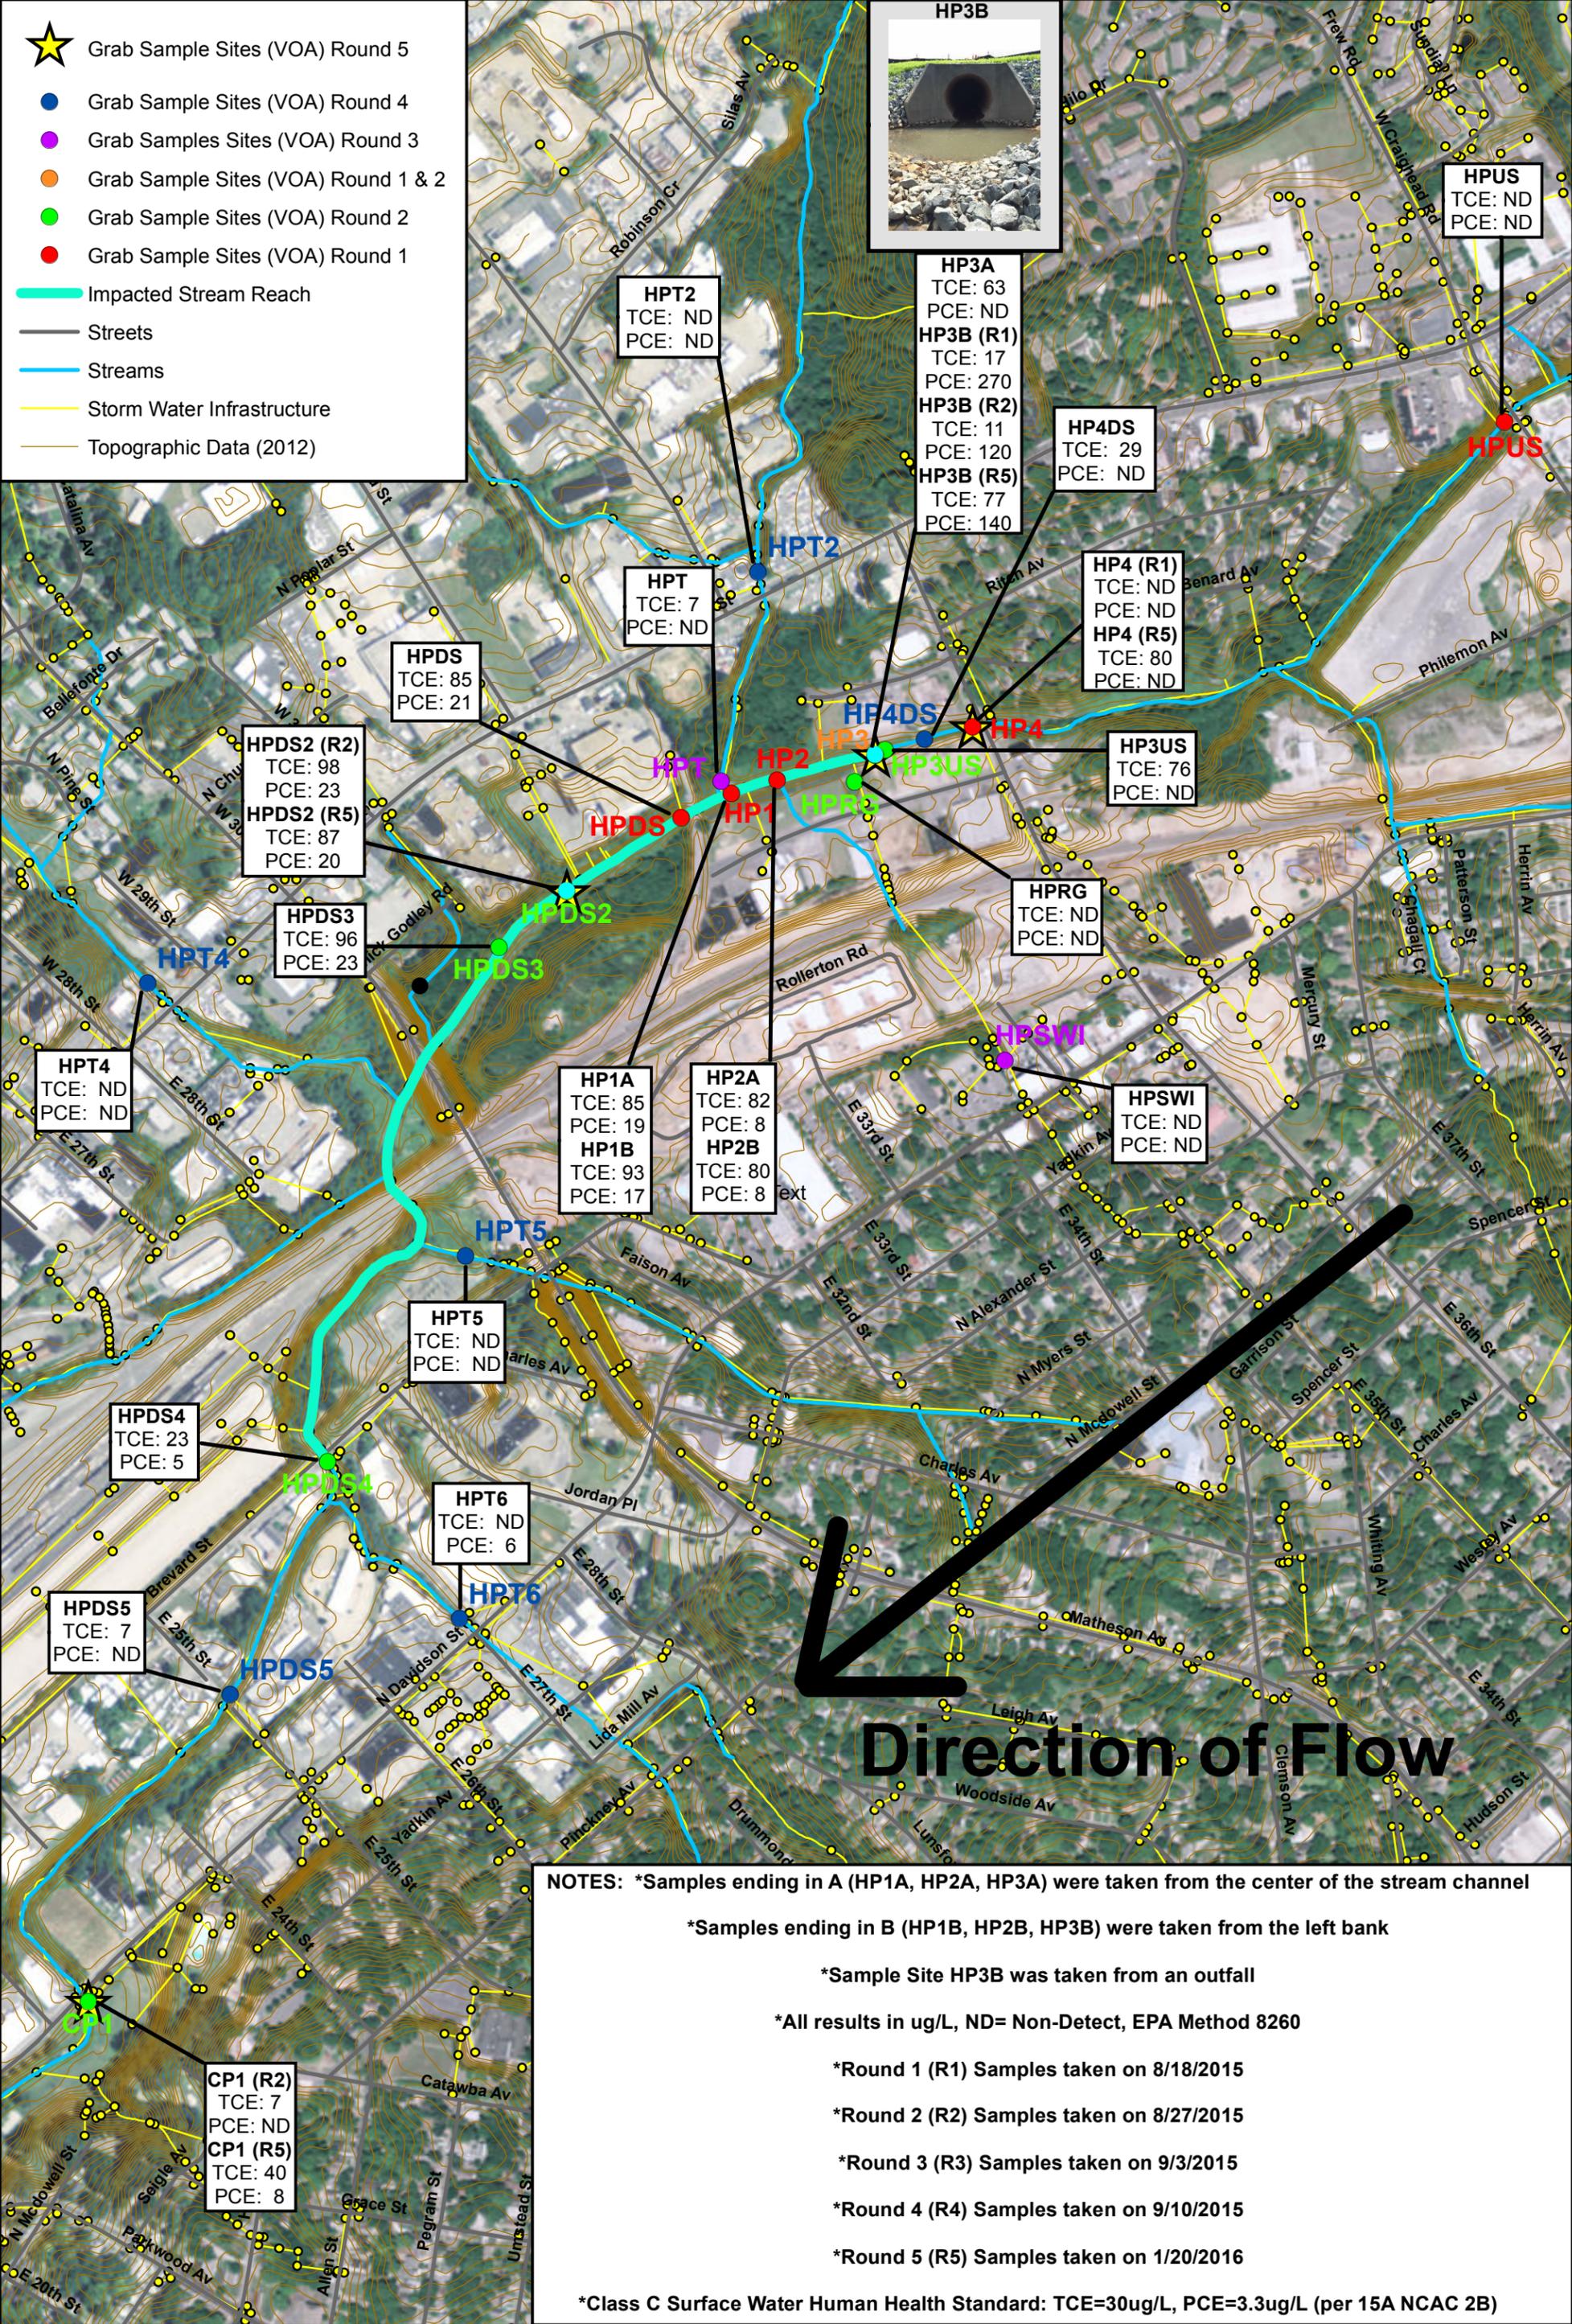


-  Grab Sample Sites (VOA) Round 5
-  Grab Sample Sites (VOA) Round 4
-  Grab Sample Sites (VOA) Round 3
-  Grab Sample Sites (VOA) Round 1 & 2
-  Grab Sample Sites (VOA) Round 2
-  Grab Sample Sites (VOA) Round 1
-  Impacted Stream Reach
-  Streets
-  Streams
-  Storm Water Infrastructure
-  Topographic Data (2012)

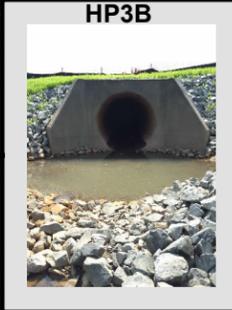

NOTES: *Samples ending in A (HP1A, HP2A, HP3A) were taken from the center of the stream channel

*Samples ending in B (HP1B, HP2B, HP3B) were taken from the left bank

*Sample Site HP3B was taken from an outfall

*All results in ug/L, ND= Non-Detect, EPA Method 8260

*Round 1 (R1) Samples taken on 8/18/2015


*Round 2 (R2) Samples taken on 8/27/2015

*Round 3 (R3) Samples taken on 9/3/2015

*Round 4 (R4) Samples taken on 9/10/2015

*Round 5 (R5) Samples taken on 1/20/2016

*Class C Surface Water Human Health Standard: TCE=30ug/L, PCE=3.3ug/L (per 15A NCAC 2B)

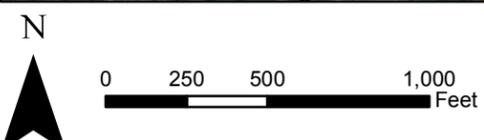

Map prepared by: Andrew DeCristofaro
Charlotte-Mecklenburg Storm Water Services
February 11, 2016