

EXHIBIT A

10445696

RECEIVED
MAR 30 1994
Industrial Pre-treatment

RECEIVED
MAR 30 1994
Industrial Pre-treatment

LEGEND

- o - VALVE
- - PUMP
- - FILTER
- a - CENTRIFUGE
- b - FILTER SYSTEM
- c - HEATER
- Δ - FIRE EXTINGUISHERS

BLUE LINES - TREATED WATER TO POTW
BLACK LINES - FLOC TRANSFER
GREEN LINES - UNTREATED WATER TRANSFER
RED LINES - OIL PROCESS TRANSFER

REVISED

FEB 2 1993

Industrial Pre-treatment


PURPLE LINES - CHEMICAL FEED

REVISED and UPDATED

March 30, 1994

REVISED and UPDATED

March 30, 1995

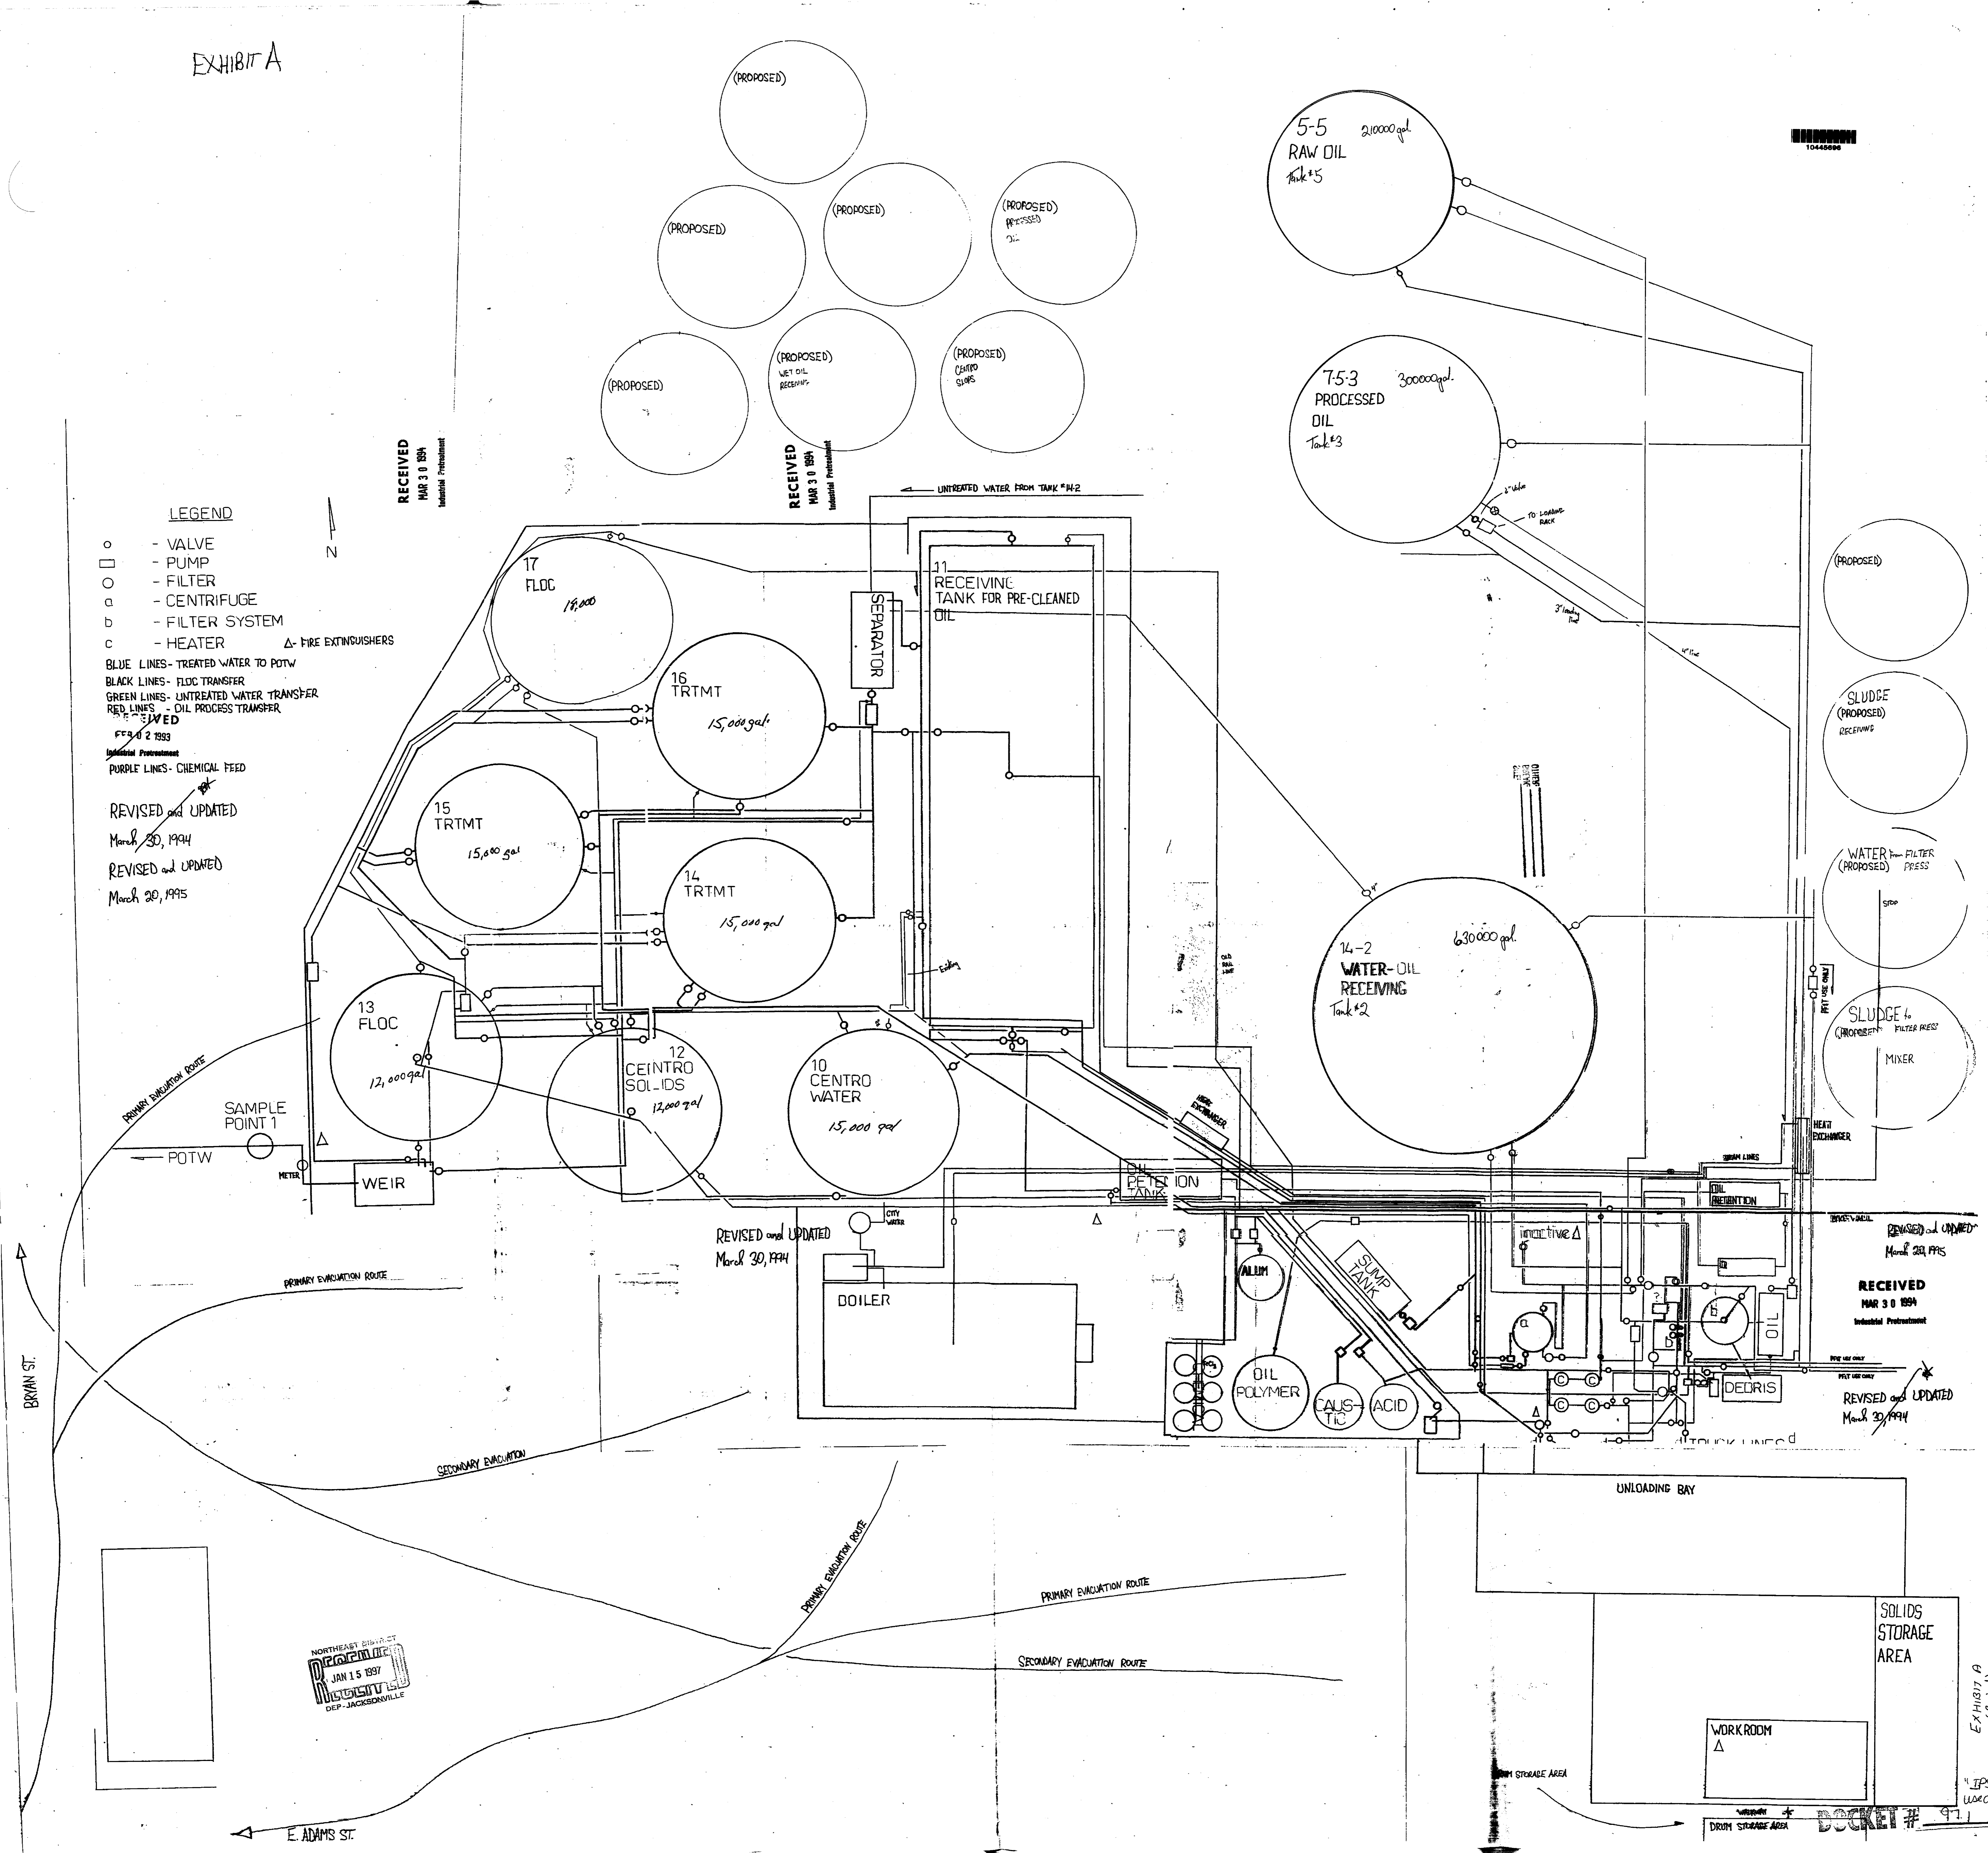

(PROPOSED)

SLUDGE (PROPOSED) RECEIVING

WATER (PROPOSED) FROM FILTER PRESS

SLUDGE (PROPOSED) FROM FILTER PRESS

MIXER

HEAT EXCHANGER

REVISED and UPDATED
March 30, 1995

RECEIVED
MAR 30 1994
Industrial Pre-treatment

REVISED and UPDATED
March 30, 1994

UNLOADING BAY

SOLIDS STORAGE AREA

WORKROOM

DOCK # 971