


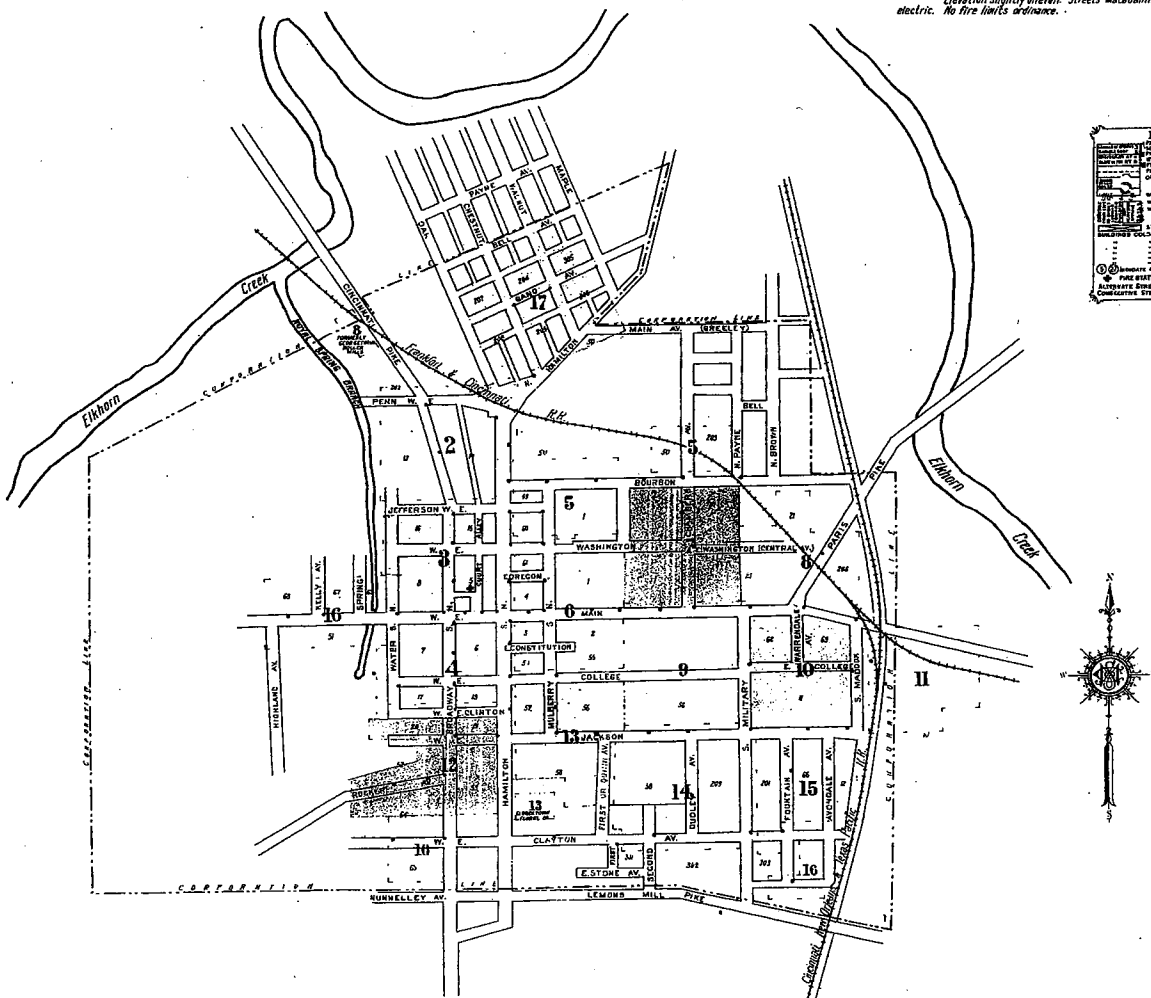

[illegible]

Insurance Maps of

# Georgetown

SCOTT COUNTY KENTUCKY

JUL 27 1912

**SANBORN** **MAP COMPANY**

11 Broadway, New York

SCALE 50 FT. TO AN INCH

JUNE 1912

Copyright 1912, by the Sanborn Map Co.

QMF 20020

*Population 6,500. Prevailing Winds, S. W.*

### WATER FACILITIES

**MPTER 742121J**  
Georgetown Water Company. Direct pressure system of water works.  
Water supply from Alexandria-Berlin Spring. Water pumped from filter pumps directly  
into mains, by one stage pump, capacity 500 gals. per 24 hours.  
Capacity of reservoir at foot of Laurelton-Borden duplex pumps, capacity,  
one million gals. per 24 hours.

No miles of water pipes, 4 to 12 diam. System installed in 1889, remodeled  
and increased 50% in 1907. 7½ double hydrants. Domestic 75 lbs. fire pressure  
115 lbs. Average daily consumption 500,000 galls.

**FIRE DEPARTMENT**

Volunteer. Seven men. One paid man sleeps at fire station.  
Two horses swingling harness. One hose wagon with 800 ft. 2 1/2" hose, one 40 gal.  
chemical tank and two 3 gall. extinguishers. 100 FT. 2 1/2" hose in reserve.  
Garnett fire alarm system. 10 boxes.  
Elevation slightly uneven. Streets Macadamized. Public lights  
electric. No fire limits ordinance.

